


Potrošač	električni kotao	rezerva	rezerva	rezerva	iz GRO kotlarnice sa rezervnih osigurača 63A	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	klima uredaj	rezerva	rezerva	rezerva	
Faza	L1 L2 L3	L1	L2	L3		L1	L2	L3	L1	L2	L3	L1	L2	L3	L1	L2	L3	L1	L1	L2	L3
Komada	1					1	1	1	1	1	1	1	1	1	1	1	1	1			
Pi (W)	36000					1250	1250	1250	1250	2000	2000	1250	1250	1250	1250	2000	2000	2000			

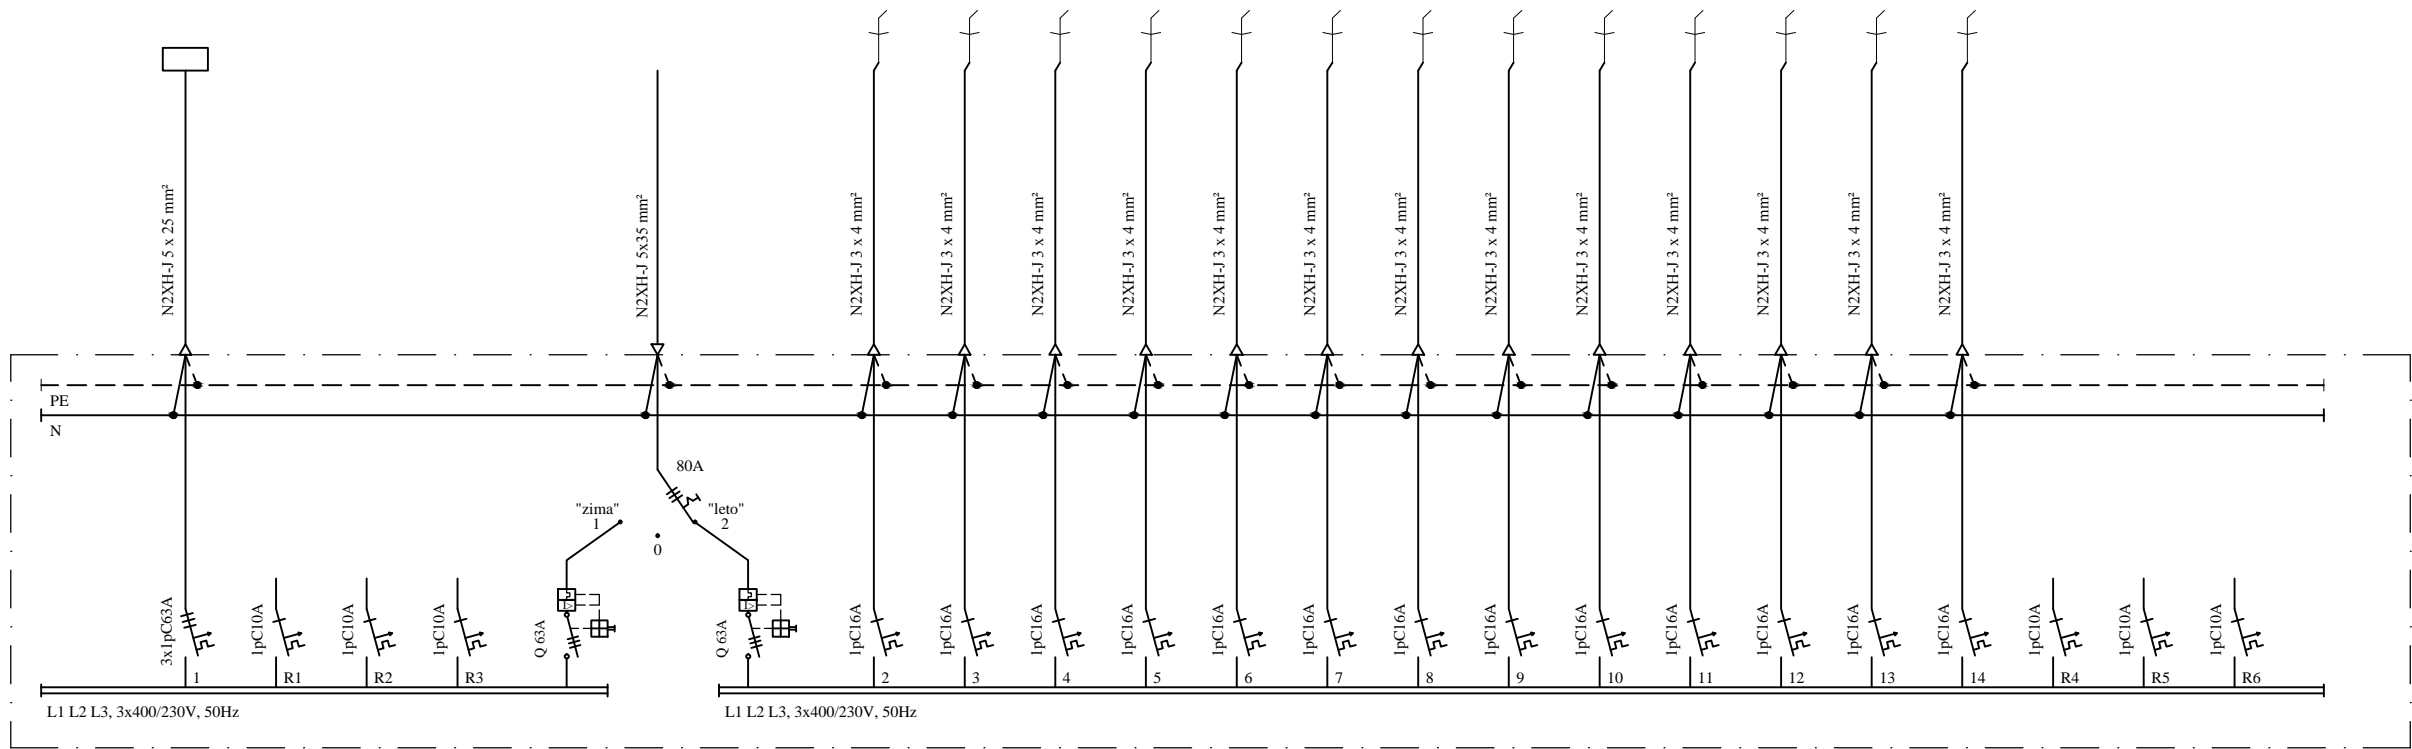

RO-HVAC  
TN-C-S

$P_i = 54750W$   
 $k_j = 0,66$   
 $P_j = 36000 W$   
 $\cos \varphi = 0,99$   
 $I_j = 54,54 A$